


REDUCED PRESSURE ZONE ASSEMBLY

NOTES:
 1) STRAINERS SHALL NOT BE USED FOR FIRE PROTECTION LINES.

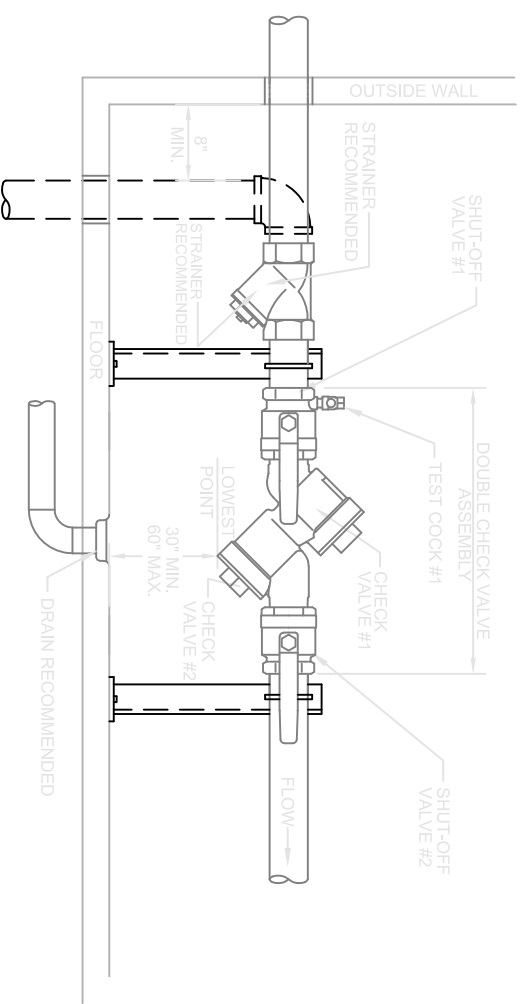

DOUBLE CHECK VALVE ASSEMBLY

TYPICAL PLUMBING SEQUENCE:

SHUT OFF VALVE – METER – SHUT OFF VALVE –
 STRAINER – BACKFLOW DEVICE – SHUT OFF VALVE –
 PRESSURE REDUCING VALVE – SHUT OFF VALVE –
 SERVICE

FIRE SERVICES DON'T NEED METERS

ISSUE DATE: JANUARY 2019

TOWN & VILLAGE OF ELLICOTTVILLE

REVISIONS	DATE	COMMENTS
	2/19/2019	UPDATE FIRE SERVICE COMMENT

EVL ENG DEPT.
 WATER - W-13

